


NB TARGUSOR WIND FARM - POWER RUMP UP AFTER PIF

Group	WTG	DAY	WTG MW	WF MW
DBE 2-6	DBE 2-8	29-giu	2,3	2,3
DBE 2-6	DBE 2-9	02-lug	2,3	4,6
NB-2	NB2	05-lug	2,3	6,9
NB-1	NB4	09-lug	2,3	9,2
DBE 2-6	DBE 2-6	01-ago	2,3	11,5
DBE 2-6	DBE 2-10	05-ago	2,3	13,8
DBE8	DBE8	06-ago	2,3	16,1
NB-1	NB1	07-ago	2,3	18,4
NB-1	NB5	08-ago	2,3	20,7
NB-1	NB6	09-ago	2,3	23,0
NB-1	NB17	10-ago	2,3	25,3
NB-1	NB15	12-ago	2,3	27,6
NB-1	NB16	13-ago	2,3	29,9
NB-1	NB14	14-ago	2,3	32,2
NB-2	NB3	15-ago	2,3	34,5
NB-2	NB8	16-ago	2,3	36,8
NB-2	NB12	17-ago	2,3	39,1
NB-2	NB7	19-ago	2,3	41,4
NB-2	NB13	20-ago	2,3	43,7
NB-2	NB11	21-ago	2,3	46,0
NB-2	NB10	22-ago	2,3	48,3
DBE 2-2	DBE 2-2	23-ago	2,3	50,6
DBE 2-2	DBE 2-4	24-ago	2,3	52,9
DBE 2-2	DBE 2-5	26-ago	2,3	55,2
DBE 2-2	DBE 2-1	27-ago	2,3	57,5
DBE 2-2	DBE 2-3	28-ago	2,3	59,8

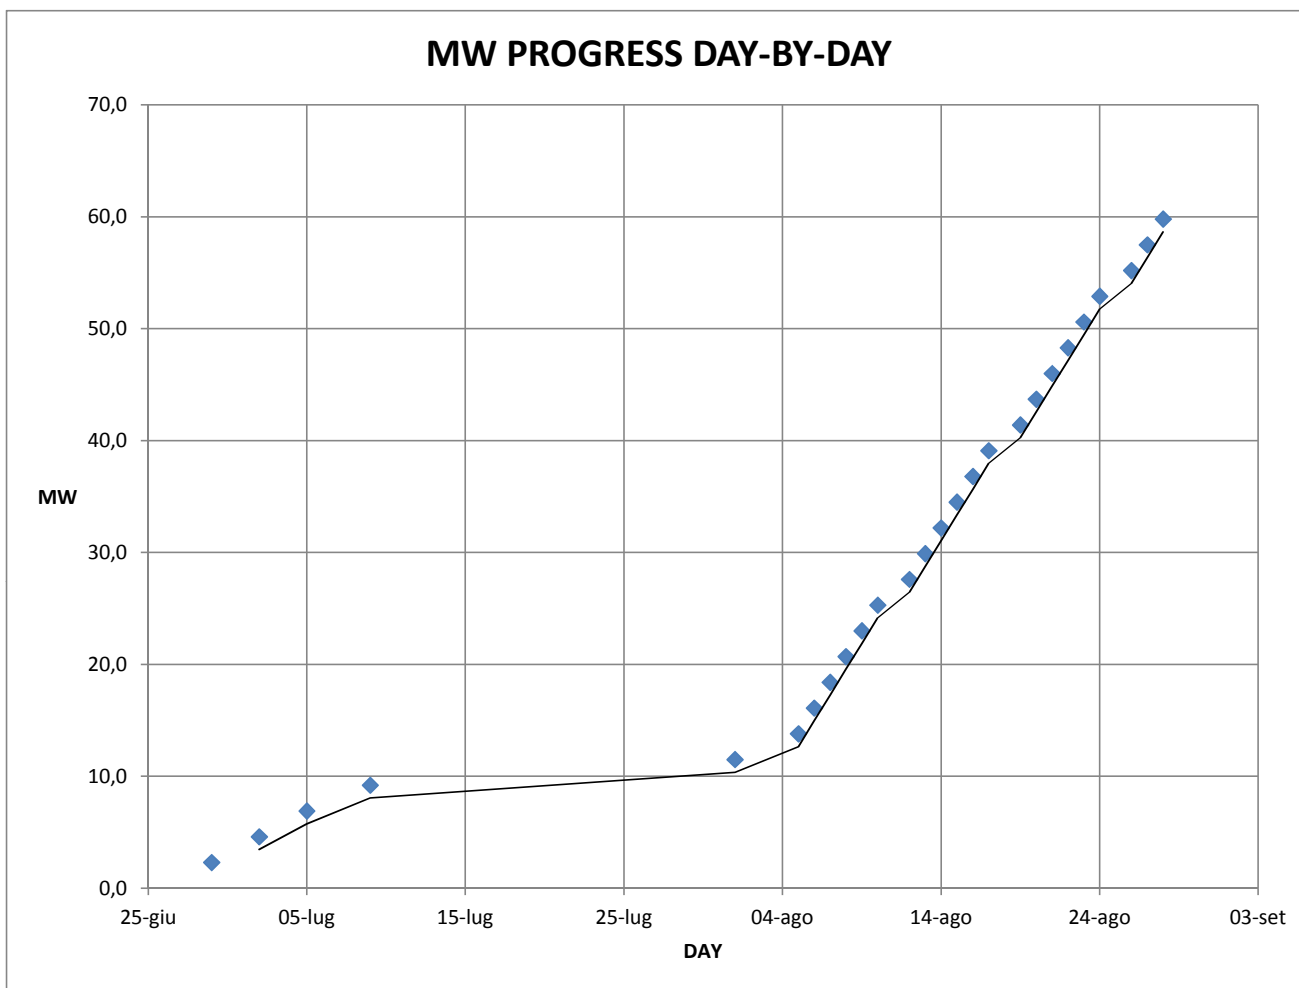

NOTES

Schedule is valid if no alarms or failures will occur and if weather allows to work

'Day' is 'Working Day'

Sequence of Groups and WTGs is only a reference and can change if operating conditions will make it necessary

WTGs need warm-up; low temperatures can cause delay

Legenda

WTG : Wind Turbine Generator

WF : Wind Farm

